



Republic of the Philippines
Department of Labor and Employment

Maritime Training Council

MEMORANDUM CIRCULAR NO. 14
Series of 2002


TO : ALL CONCERNED

SUBJECT : DIAGRAM OF HIGH EXPANSION FOAM GENERATOR
and THREE-SIDED BRICK TRAY

DATE : 04 April 2002


Further to Memorandum Circular No. 02, series of 2002, please refer to the attached diagrams of the High Expansion Foam Generator and Three-sided Brick Tray. Both are required training equipments for Fire Prevention and Fire Fighting and Advanced Training in Fire Fighting.

For guidance.



RAMON T. TIONLOC JR.
Acting Executive Director

Memo FE&ATFF
JST

THREE -SIDED BRICK TRAY

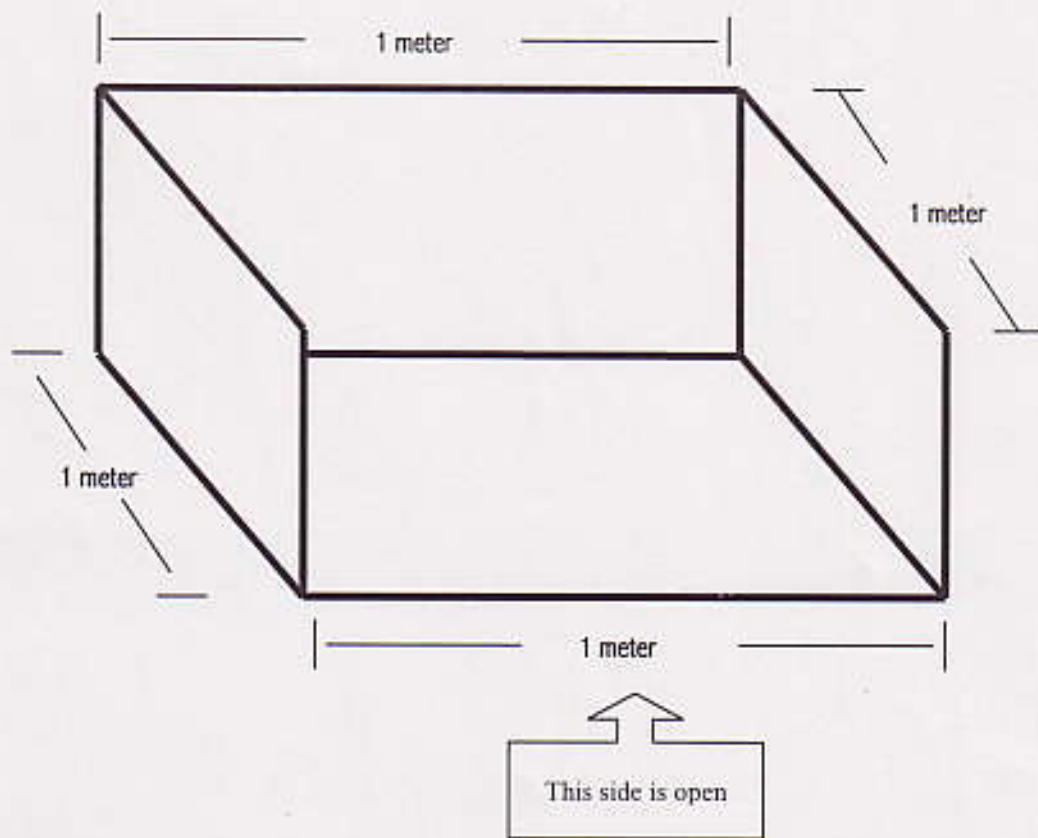

* Dimensions mentioned are required as the minimum measurement

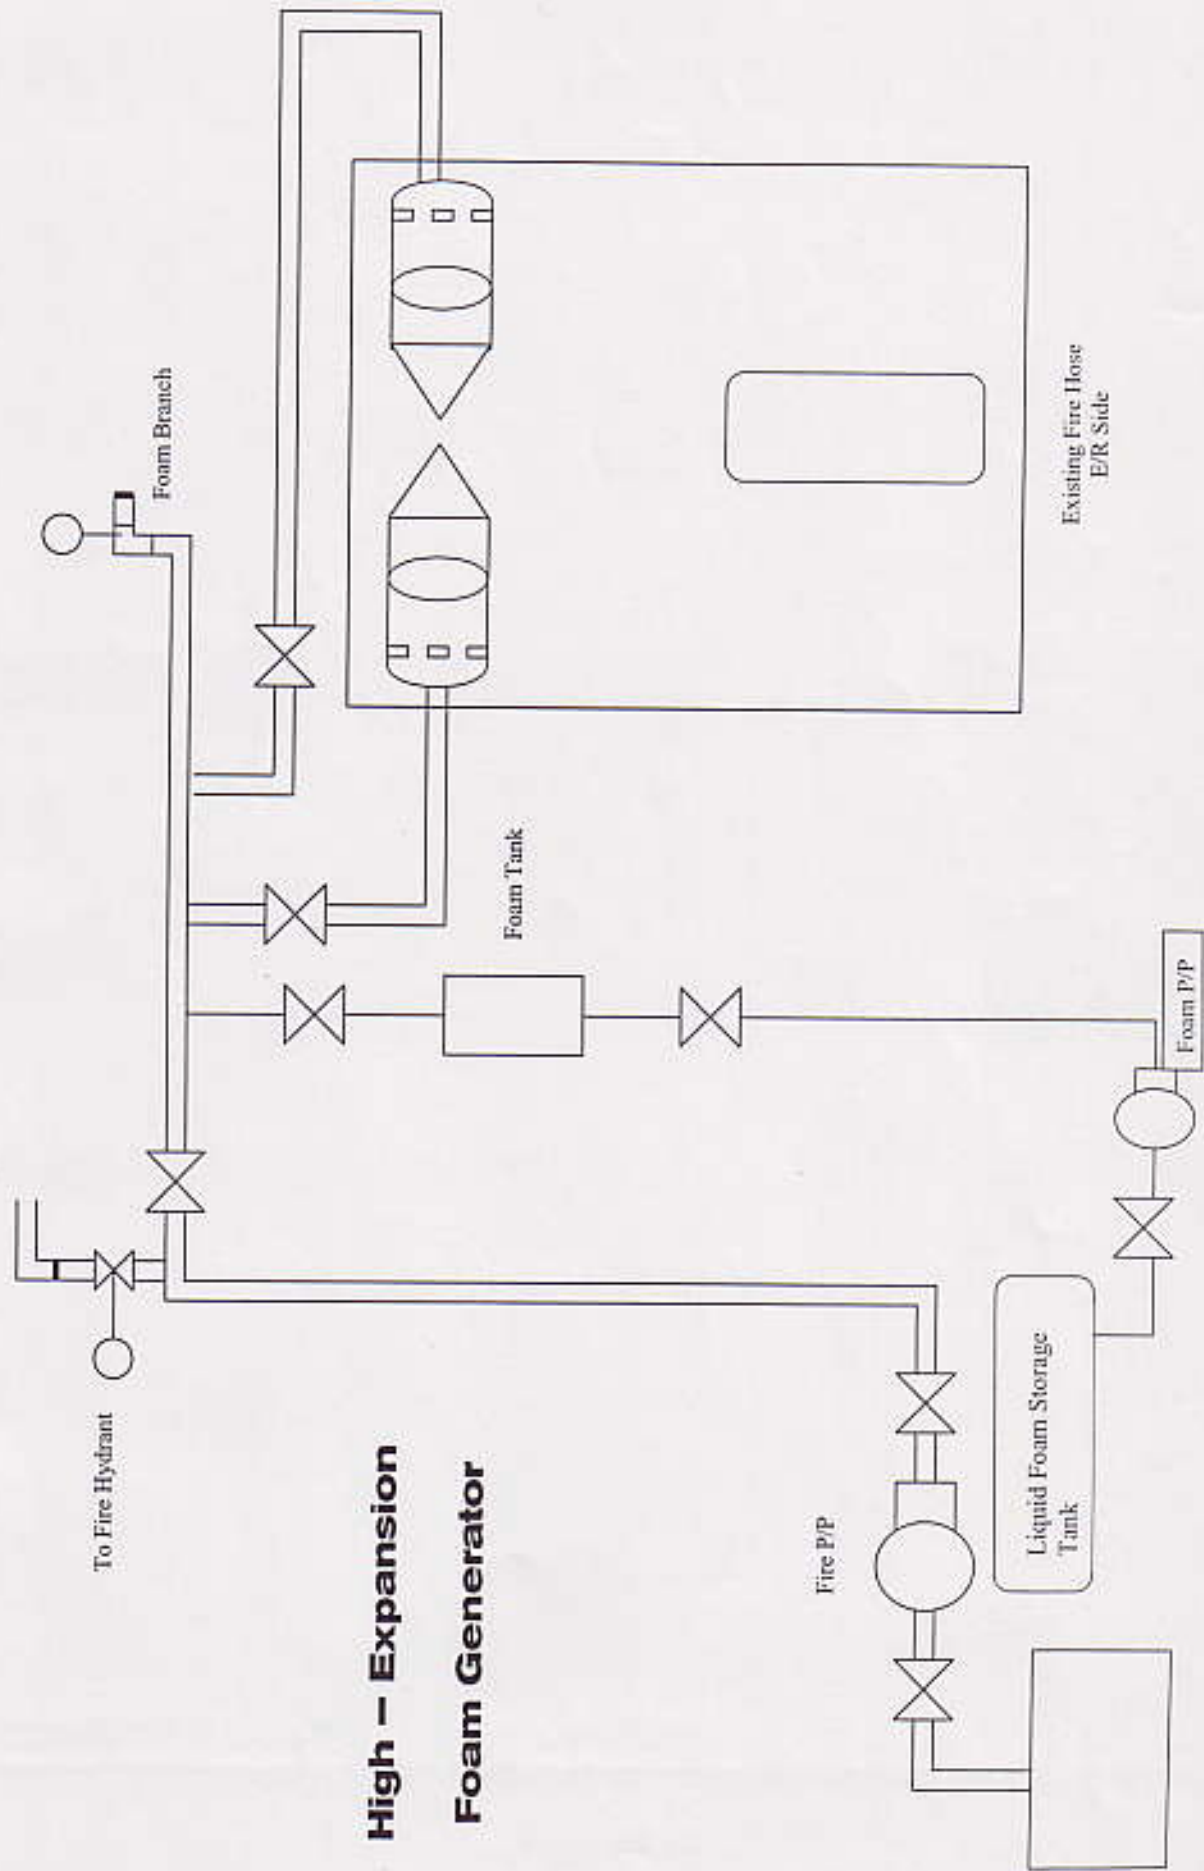

**High - Expansion
Foam Generator**

To Fire Hydrant

Foam Branch

Foam Tank

Foam P/P

Liquid Foam Storage Tank

Existing Fire Hose E/R Side

Foam P/P